



TENNESSEE DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF WATER RESOURCES

CERTIFICATE OF COMPLETION OF SUBSURFACE SEWAGE DISPOSAL
SYSTEM

Issued

to: Martin Thompson

Owner, Developer, Contractor, Installer, Etc.

Location:

517 Pleasant Grove Rd.

Springville, TN 38256-

County: Henry

Map-Group-Parcel: 112--12.00000000

Subdivision:

Lot:

Type of System:

- ☒ Conventional
☐ Modified Conventional
☒ Conventional System Substitute
☒ Chamber
☐ Poly Expanded Styrene
☐ Large Diameter Gravelless Pipe
Gravel Backfill in a 24" trench required?
☐ Low Pressure Pipe
☐ Mound
☐ Lagoon
☐ Subsurface Drip System
☐ Other

welch

1500

Septic Tank

(Septic Tank Manufacturer)

(Volume)

Estimated Absorbtion Rate: 75 No. of Bedrooms: 0
(minutes per inch)

☒ New Installation ☐ Repair Existing System ☐ Modification

Effluent Pump? yes Effluent Pump Tank Volume 1500

Effluent Pump Manufacturer: welch

Electrical Inspected? yes

Electrical Inspection Ticket #: 522175

Electrical Inspection Date: _____

Installed by: Robertson Backhoe

Installer email: robertsonbackhoe@gmail.com

Is system approved? yes

If no, specify why system is not approved:

Please see attachments for supporting documentation.

Inspected by: Justin Chilcutt

03/05/2019

(Name and Title)


(Date)

MARTIN THOMPSON

14 RV Sites

517 Pleasant Grove Rd
Springville, UT 84656

Line 1 5'6" Top Chamber Top Hump 5'3"
Line 2 6'11" Top Chamber Top Hump 6'9"
Line 3 8'3" Top Chamber Top Hump 7'11"
Line 4 9'10" Top Chamber Top Hump 9'6"
Line 5 10'11" Top Chamber Top Hump 10'7"
Line 6 12'1" Top Chamber Top Hump 11'11"
Line 7 13'7" Top Chamber

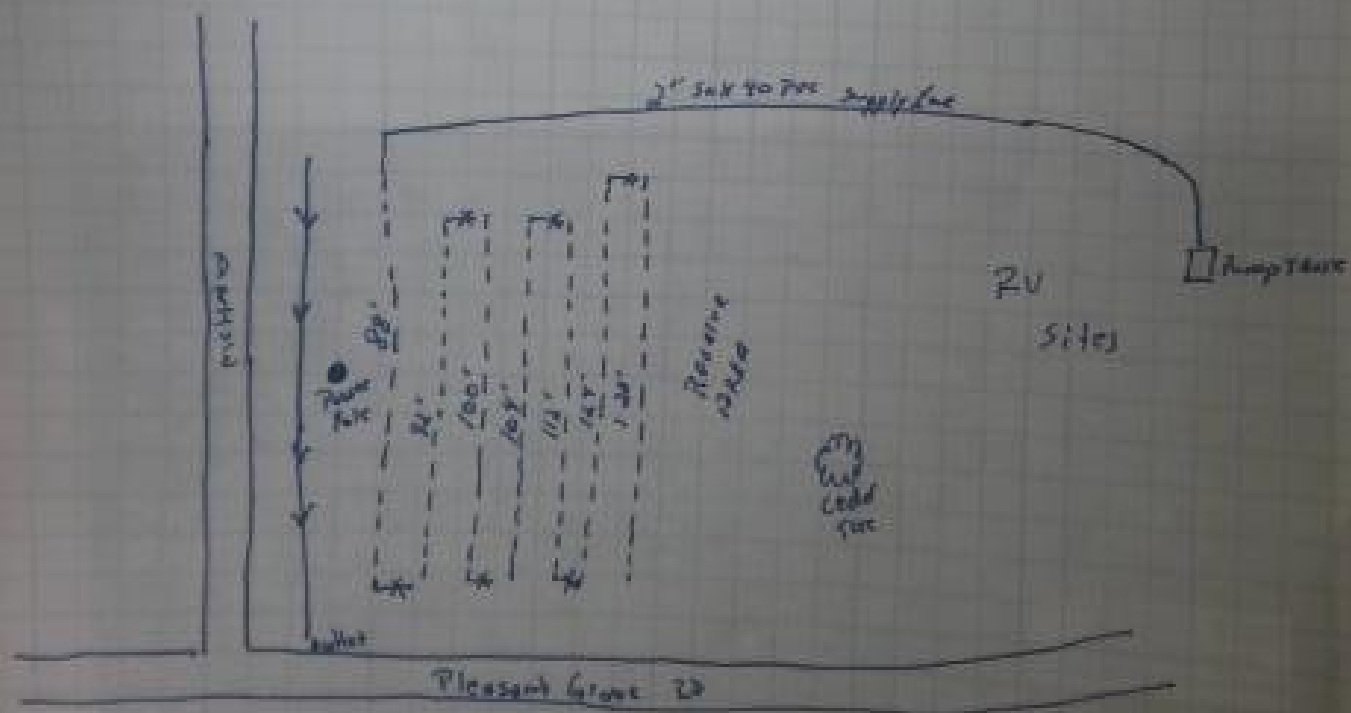







State of Tennessee Electrical Inspection
APPROVED

Form #

522175

Date _____

2/19

Type RI

Final

Occupancy Authorization (# of floors)

Deputy Electrical Inspector